


COVER PER SUBMITTAL

6"Dia

TOP VIEW

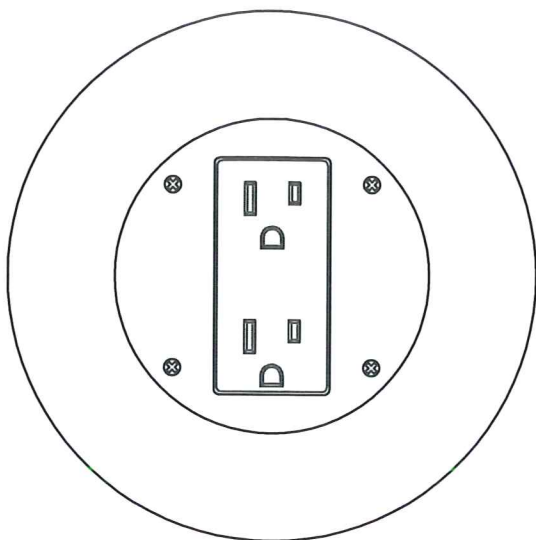


MOI-SLB-DP1

1 decora duplex receptacle

## NOTE:

Duplex receptacle shall be 5-15RA.  
5-20RA available

## CROSS SECTION

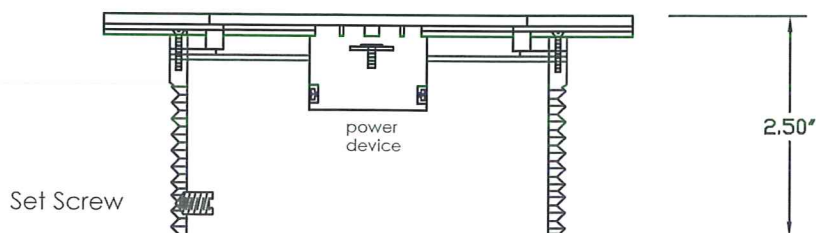


DEVICE MOUNTING BRACKET  
C/W THREAD HUB AS SHOWN

2.50"

Set Screw

power device

Poured in slab

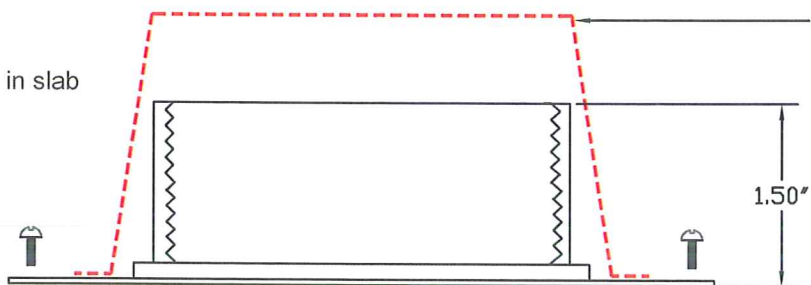


PLASTIC CONE

1.50"

8"x8" SCREW ON COVER (4 CORNERS)  
C/W THREAD HUB AS SHOWN

MOUNT +1"min. to 2" max. BELOW NEW TILE

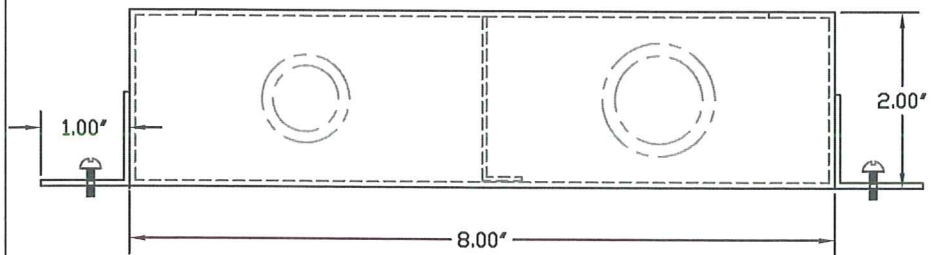

8"x8"x2" STANDARD BOX  
WITH CENTRE BARRIER  
C/W 2x[1/2-3/4"] k.o's  
2x[3/4"-1"] k.o's

2.00"

8.00"

## NOTE:

Duplex receptacle shall be CSA / UL Recognized/Classified or Listed

## ORDERING INFO-(SEE ABBREVIATIONS)

SLAB THICKNESS

RECEPT.TYPE/colour

DATA MANUF./colour


COVER TYPE

## PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS  
DRAWING IS THE SOLE PROPERTY OF  
NOCOM. ANY REPRODUCTION IN  
PART OR AS A WHOLE WITHOUT THE  
WRITTEN PERMISSION OF NOCOM  
IS PROHIBITED.

		DIMENSIONS ARE IN MM TOLERANCES: ANGLES: ± DEGREE LINEAR: ± MM (UNLESS SPECIFIED)	
		MATERIAL See Variant table	
		FINISH	
NEXT ASST	USED ON		
APPLICATION		DO NOT SCALE DRAWING	

	NAME	DATE (yy-mm-dd)
DRAWN	TJP	10-03-02
CHECKED		
ENG. APPR.		
MFG APPR.		
Q.A.		
COMMENTS:		

JOB TITLE:		
 <b>LEW ELECTRIC FITTINGS COMPANY</b>		
877-537-2019 www.lewelectric.com		
SIZE A	DWG. NO. MOI-SLB-DP1	REV.
SCALE=n.t.s.	WEIGHT:	SHEET 1 OF 1